




Fire Door Stop Top System

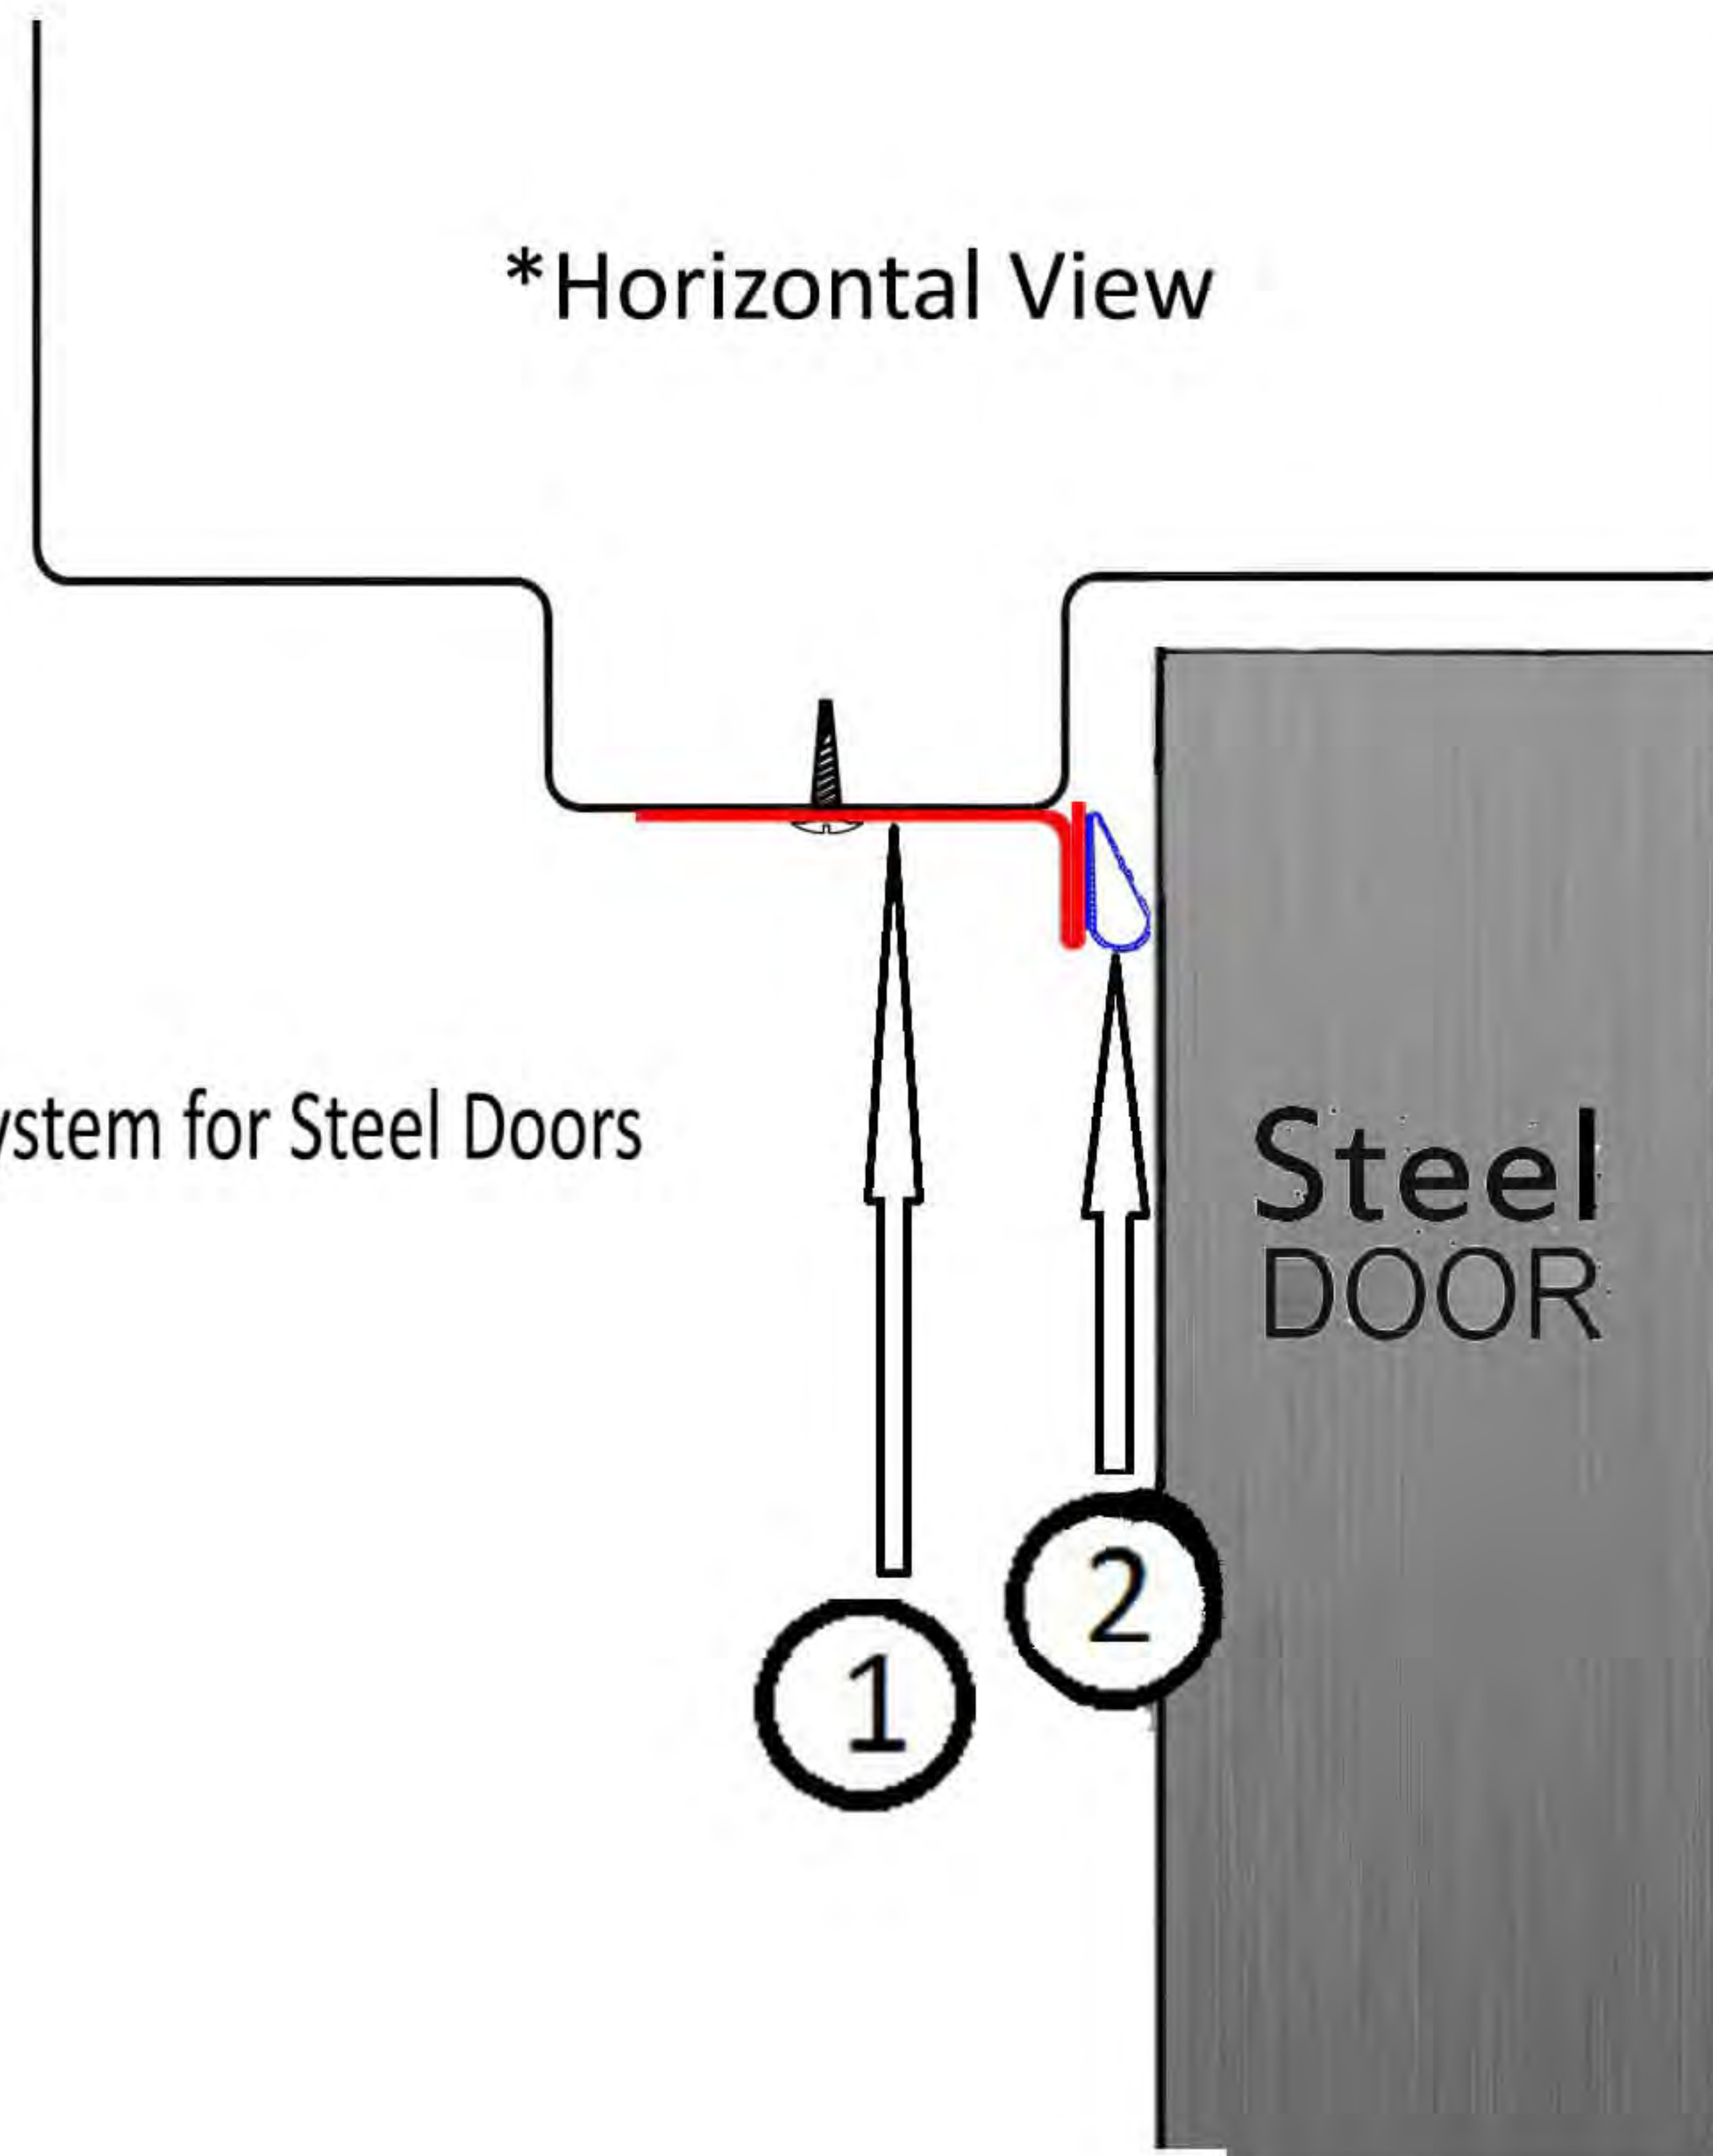

- ① The Crown Fire Door Stop Top System for Steel Doors
- ② Intumescent Smoke Seal

- UL listed for excessive clearances and gaps
- UL tested and listed to allow for excessive clearances up to 1/2" on steel doors
- UL fire-rated for up to 180 minutes
- Does not increase or decrease your fire door assembly's existing fire rating
- Tested under NFPA-252 with hose stream, ANSI/UL 10B with hose stream, UL 10C, CAN/ULC S104-10

Crown Fire Door Products, Inc.
Sanford, Maine, USA.

www.crownfiredoorproducts.com/

US Patent Nos. 9,151,106 & 9,518,422
Canadian Patent Nos. 2,846,726 & 2,939,255

